


Axi-Therm Chemical



CLEAN 5 **Express** (System Cleaner)

- Ⓐ Provides energy savings by removing oil residue and metal oxides in **existing** hydronic systems
- Ⓐ Restores heat transfer and water circulation to their original levels
- Ⓐ Easy to use, the heating system can be cleaned both with the boiler on or off
- Ⓐ Reduces maintenance costs
- Ⓐ Neutral pH does not corrode or damage gaskets, plastics, or metals (steel, copper, and aluminum)
- Ⓐ Eco friendly chemicals do not contain harmful or hazardous substances
- Ⓐ Low concentration requirements
- Ⓐ Also available in 500 mL (16.9 oz.), 2 litres (½ U.S. gallon) bottles, and 20 L (5 U.S. gallon) jug

Dosage: 0.24%

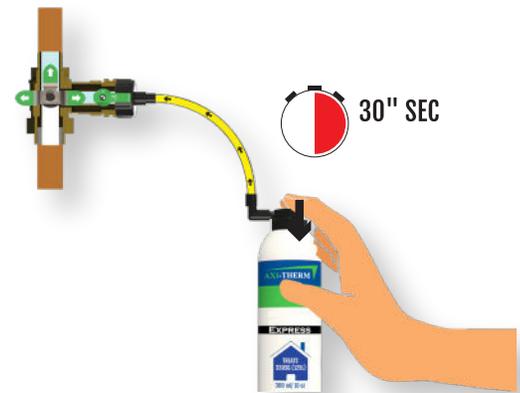

Suitable for all kinds of hydronic heating and cooling systems: traditional hydronic heating systems, chilled water systems, and geothermal systems. Provides energy savings by removing oil residue and metal oxides from hydronic systems. Safe for use with all metals (steel, copper and aluminum)

✉ info@axiomind.com

☎ (877)651-1815

🌐 WWW.AXIOMIND.COM

AXI-THERM




CLEAN 5 EXPRESS TECHNICAL INFORMATION

DIRECTIONS:

Add 1 bottle (300 mL or 10 oz.) of AXI-THERM CLEAN 5 (Express) for every 125 litres (33 gallons) of water (Dosage: 0.5 %). It must circulate for at least 2 days when using the existing system circulator. The product may remain in the system for up to 30 days and the boiler may be on or off during the cleaning period. Flushing the system with a(Flush cart) can reduce the cleaning operation to 2 to 4 hours. Once the cleaning operation is completed, the system should be well drained and rinsed. Rinsing should continue until the water runs clear.

If the water does not run clean, repeat the cleaning session. Refill the system with demineralized water provided by an Axiom PUROPAL demineralizer. Add AXI-THERM PROTECT-1 for complete system protection.

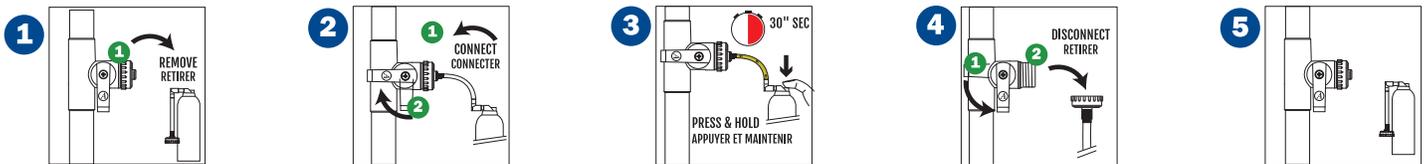

ENVIRONMENTAL AND SAFETY INFORMATION :

For professional use only.

Before adding to the system, ensure that the system water does not contain other chemicals. Lower concentrations do not yield satisfactory results. Higher concentrations have no adverse effects.

Do not use in potable water systems. Do not ingest. Do not dispose of waste through the environment. Keep out of reach of children. The product is not classified according to the Globally Harmonized System (GHS).

SKU	Purpose	Bottle Size	Treatment Volume	Case Qty
AXTH-C5-500mL	Chemical Cleaner for OLD Hydronic Systems	500mL (16.9oz)	100 litres (25 gal)	12
AXTH-C5-2L	Chemical Cleaner for OLD Hydronic Systems	2L (67.6 oz.)	400 litres (100 gal)	6
AXTH-C5-20L	Chemical Cleaner for OLD Hydronic Systems	20L (5.28 gal)	4000 litres (1060 gal)	1
AXTH-C5X-300mL	Chemical Cleaner for OLD Hydronic Systems	300mL (10 oz.)	125 litres (33 gal)	10

ACCESSORIES :

- AXTH- Water Test** -- Axi-Therm Boiler Water Quality Titration Test Kit
- PuroPal-1** -- Disposable Demineralizer Cartridge

Project	<input style="width: 95%;" type="text"/>	Location	<input style="width: 95%;" type="text"/>
Consultant	<input style="width: 95%;" type="text"/>	Contractor	<input style="width: 95%;" type="text"/>
Unit Tag	<input style="width: 95%;" type="text"/>	Sales Agent	<input style="width: 95%;" type="text"/>